


DESIGN DATA
 OFFICE, 45 PEOPLE @ 20 G.P.D. = 900 G.P.D.
 PERC RATE: 2 MINS/INCH, USE BED @ 1.0 S.F./GAL.
 1.0 x 900 = 900 S.F. REQUIRED. OR 24' x 28'
 USE BED 24' x 60' = 1440 S.F.
 SEPTIC TANK: 150' x 900 = 1350, USE 1500 GAL. TANK

SEE TEST PIT DATA & ORIGINAL DESIGN BY C.A. PICKERING ASSOC. DATED MARCH 3, 1977.

D'ANGELO, INC.
 SEWAGE DISPOSAL REPAIR
 WEST BRIDGEWATER, MASS.
 ASSESSORS SHEET B-7
 LOT 38-3

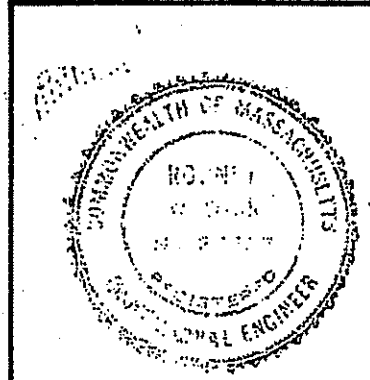

CAPUTO AND WICK LTD.
 1150 PAWTUCKET AVE.
 RUMFORD, R.I. 02916
 401-434-8880

AS-BUILT
 JULY, 1985

DATE 5/85
 SHEET 1 OF 1